

TREATMENT OF DISPATCHABLE LOADS IN NEM

PREPARED BY: Market Operations
DOCUMENT NO: 140-0070
VERSION NO: 003
EFFECTIVE DATE: 01/07/2010
ENTER STATUS: Final

Description

NEM start-up pre-condition 9.6 required NEMMCO (now AEMO) to:

“Document procedures for the utilisation of dispatchable load and systems for accessing.”

This pre-condition had to be satisfied prior to the proclamation of the National Electricity Law and commencement of the NEM on 13th December 1998.

Scope of Document

This pre-condition is met by the publication of this document that specifically describes the bidding and dispatch processes for dispatchable loads and how dispatchable load information is reported.

The treatment of dispatchable loads is also documented in “Pre-dispatch Process Description”, located on the AEMO website and which was also required under NEM start-up pre-condition 8.6.

This document describes the treatment of dispatchable loads in the *central dispatch process* that covers the 5-Minute or on-line Dispatch, the Five-Minute Pre-dispatch (5MPD) and the Pre-dispatch processes.

Dispatchable loads also participate in the MTPASA and STPASA processes, but this document will not describe this relationship. The registration of dispatchable loads is also not discussed in this document, but is covered in the Registration Guidelines.

References

1. Pre-Dispatch Process Description – AEMO website:
(<http://www.aemo.com.au/electricityops/dispatch.html>)
2. SPD Formulation, titled "Mathematical Modelling of the Wholesale Electricity Market Bid-Clearing System SPD: Scheduling, Pricing and Dispatch"
3. National Electricity Rules

Note Table 1 of this document refers to various dispatchable load equations in the SPD Formulation.

Disclaimer

- (a) **Purpose** – This dispatchable loads Guide (**Guide**) has been produced by the Australian Energy Market Operator Limited (**AEMO**) to provide information about dispatchable loads, as at the date of publication.
- (b) **No substitute** – This Guide is not a substitute for, and should not be read in lieu of, the National Electricity Law (**NEL**), the National Electricity Rules (**Rules**) or any other relevant laws, codes, rules, procedures or policies. Further, the contents of this Guide do not constitute legal or business advice and should not be relied on as a substitute for obtaining detailed advice about the NEL, the Rules, or any other relevant laws, codes, rules, procedures or policies, or any aspect of the national electricity market or the electricity industry.
- (c) **No Warranty** – While AEMO has used due care and skill in the production of this Guide, neither AEMO, nor any of its employees, agents and consultants make any representation or warranty as to the accuracy, reliability, completeness or suitability for particular purposes of the information in this Guide.
- (a) **Limitation of liability** - To the extent permitted by law, AEMO and its advisers, consultants and other contributors to this Guide (or their respective associated companies, businesses, partners, directors, officers or employees) shall not be liable for any errors, omissions, defects or misrepresentations in the information contained in this Guide, or for any loss or damage suffered by persons who use or rely on such information (including by reason of negligence, negligent misstatement or otherwise). If any law prohibits the exclusion of such liability, AEMO's liability is limited, at AEMO's option, to the re-supply of the information, provided that this limitation is permitted by law and is fair and reasonable.

© 2010 - All rights reserved.

Introduction

Dispatchable loads are herein referred to as *scheduled loads*. Under the Rules, *scheduled loads* are net consumers of electricity that register to participate in the *central dispatch* and pricing processes operated by AEMO.

For the purposes of economic scheduling of electricity to meet demand, scheduled loads are essentially treated on equal terms with scheduled generating units with no dispatch models designed to favour scheduling from one type of unit over another. In this document the models described for scheduled loads equally apply for scheduled generating units unless otherwise specified.

Furthermore, the same participant interfaces are available for the bidding, dispatch and market reporting of scheduled generating units and scheduled loads.

However, market participants with registered scheduled loads should specifically be aware of:

- The expected structure of their dispatch bids and how the central dispatch process interprets these bids;
- Market ancillary services offer data and how the central dispatch process interprets this data;
- The other data required by the central dispatch process;
- Modeling in the dispatch algorithm that is specific to scheduled loads;
- The interpretation of load dispatch instructions.


Dispatch Inputs

Energy Bids

Clause 3.8.7 of the Rules covers the structure of dispatch bids. A sample dispatch bid structure for a scheduled load is illustrated in Figure 1 below.

The components of a dispatch bid are described in the following sections. This is followed by a worked example explaining how the dispatch bid is used in the central dispatch process.

FIGURE 1 : TYPICAL DISPATCH BID FOR SCHEDULED LOAD

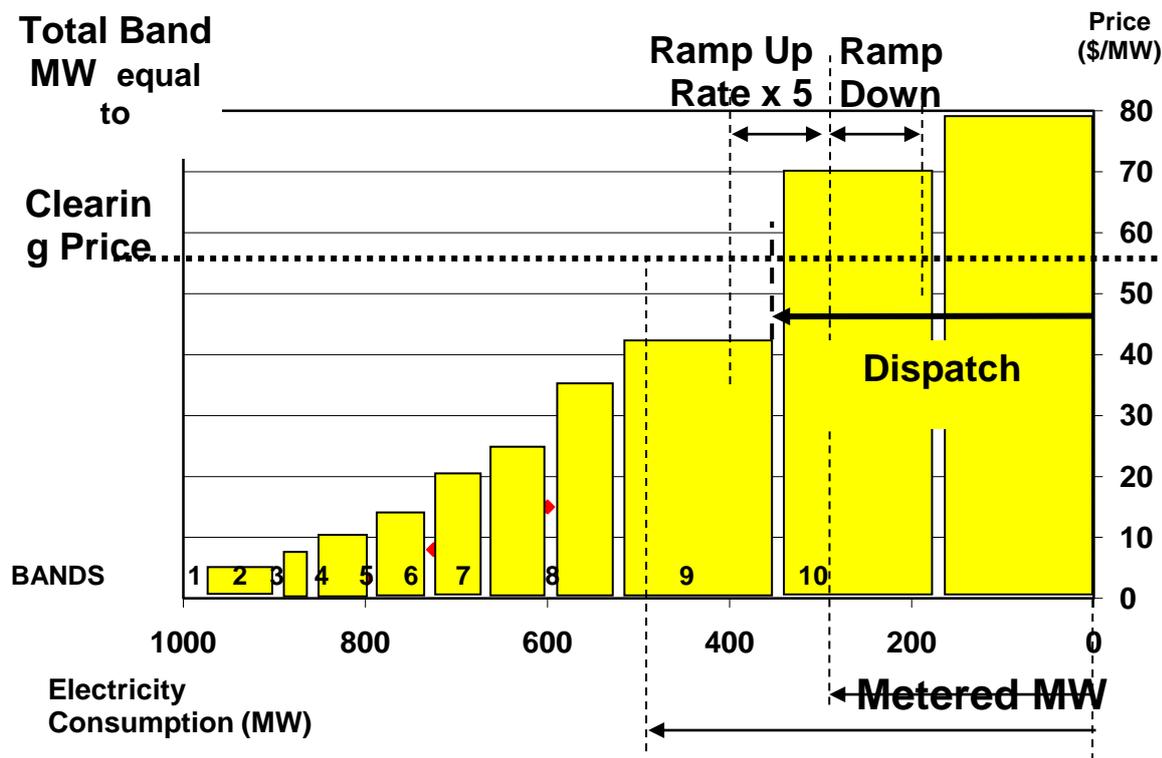

Energy Bands

In a schedule load’s daily energy dispatch bid the market participant must submit the maximum capacity registered for that scheduled load in the form of ten price bands. Each price band associates a quantity of electricity consumption at the load’s local connection point with a local price for the scheduling of that quantity of electricity.

The price specified for a price band (herein called bands) is interpreted in the central dispatch process as the market clearing price at or below which the scheduled load will increase electricity consumed by up to the MW increment specified in that price band.

Restated, each band price represents the maximum market clearing price that the market participant is willing to pay before decreasing the electricity consumption of their scheduled load by up to the MW increment in that band for the specified trading interval.

Under clause 3.8.7(h) of the Rules all band prices for scheduled loads (when referred to the relevant regional reference node via their transmission loss factor) must be:

- Less than or equal to VoLL; and
- Greater than or equal to Market Price Floor.

Energy Availability

The bid maximum electrical consumption by a scheduled load that can be scheduled for the specified dispatch or trading interval.

Energy Ramp Rates

The bid maximum rates (in MW/min) at which the electrical consumption by a scheduled load can be scheduled to increase (called the Ramp Up Rate) or decrease (called the Ramp Down Rate) over the specified dispatch or trading interval.

Energy Fixed Loading

The bid fixed level of electricity consumption by a scheduled load (in MW) to be scheduled for the specified dispatch or trading interval.

Fast Start Inflexibility (On-line Dispatch only)

A scheduled load registered as a Fast Start unit is required to submit a fast start inflexibility profile (FSIP).

This FSIP mode time and minimum loading level data represents the desired consumption profile that the scheduled load wishes to be automatically committed to by the On-line Dispatch algorithm if it is economic to do so, as determined in a first-pass Fast Start unit commitment dispatch calculation. This first-pass calculation assumes that all FSIP constraints that are normally applied to committed Fast Start units are ignored for the purposes of determining further unit commitments.

Daily Energy Constraint (Pre-dispatch only)

The bid maximum energy consumption by a scheduled load (in MW) that can be scheduled over the specified trading day.

FCAS Offers

A market participant may register a scheduled load to provide any of the Frequency Control Ancillary Services (FCAS).

Typically a scheduled load is only able to provide the fast (6 second), slow (60 seconds) & delayed (5 minute) Frequency Raise contingency services, providing a response to a sudden frequency increase through automatic under-frequency load shedding.

Once a market participant has registered a scheduled load for any of these FCAS, the market participant must submit a daily FCAS offer for that service, in a similar format to energy market dispatch bids.

The FCAS offer band price is the price (in \$/MWh) that the market participant is willing to accept in return for enabling the amount of FCAS MW response within that FCAS offer band.

Interpretation of a Dispatch Bid - a worked example

Reference: Figure 1 above.

For this example, assume that the scheduled load 'X' belongs to a region 'R'. Also assume that the maximum capacity for load 'X' = 1000 MW.

The sum of band MW in all 10 bands must therefore equal 1000 MW.

The dispatch bid submitted for load 'X' has:

Bands 1 to 8 have 620 MW priced below \$50/MWh

Band 9 has 190 MW at \$70/MWh

Band 10 has 190 MW at \$80/MWh

Availability = 500 MW

Ramp Up & Down Rate = 20 MW/minute

At the start of the dispatch run, the Metered MW consumption of load 'X' = 290 MW.

The NEMDE Solver algorithm then determines the upper and lower limits within which load 'X' can be scheduled to consume:

Upper limit = minimum of (Ramp Upper limit, Availability)

= minimum (390, 500)

= **390 MW**

where;

Ramp Upper limit

= Metered MW + Ramp Up Rate x 5 mins

$$= 290 + (20 \times 5)$$

$$= 390 \text{ MW}$$

Lower limit = Ramp Lower limit

$$= \text{Metered MW} - \text{Ramp Down Rate} \times 5 \text{ mins}$$

$$= \mathbf{190 \text{ MW}}$$

The NEMDE Solver optimisation then calculates for the dispatch interval and determines that a market clearing price (dispatch price) for region 'R' of **\$55/MWh**.

As the price of Band 10 > dispatch price, this band is fully scheduled with a consumption = 190 MW. As the price of Band 9 > dispatch price, a further 190 MW of consumption is scheduled.

At this stage the total consumption of Bands 9 and 10 = 380 MW which is still within the upper and lower limits determined above. However the remaining bands are not dispatched at all, as their band prices are all below the dispatch price (that is, the market price was not low enough to justify consumption in those bands).

Therefore the final scheduled consumption (dispatch target) of load 'X' = 380 MW.

The NEMDE Solver algorithm has scheduled an increase in the consumption of the load from zero MW, dispatching from the higher-priced to lower-priced bands until either the dispatch price falls below the price of the last band dispatched (as in this case) or the scheduled load is constrained to either its upper or lower operating limits.

Other data

SCADA metered energy consumption

Clause 3.8.2(d) of the Rules requires that certain facilities be provided before a load can participate in the central dispatch process as a scheduled load:

“(d) Dispatch bids and market ancillary service offers will only be included in the central dispatch process by AEMO if it is satisfied that adequate communication and/or telemetry is available to support the issuing of dispatch instructions and the audit of responses.”

The currently metered value of consumption of the scheduled load is required by the On-line Dispatch process in order to determine the dispatch target consumption at the end of each dispatch interval and to allow AEMO to verify conformance of the scheduled load to its dispatch target. These values are automatically captured from the AEMO SCADA database at the start of each On-line Dispatch, 5MPD & Pre-dispatch run.

A means of transmitting dispatch instructions to the scheduled load is also required.

There are similar requirements on scheduled generating units to provide currently metered outputs and data communications facilities.

Dispatch Process

The central dispatch process equitably applies the same dispatch rules and principles to both scheduled generating units and scheduled loads.

Co-optimisation of Energy and FCAS Dispatch

Under Clause 3.8.1(b) of the Rules:

“(b) The *central dispatch* process should aim to maximise the value of *spot market* trading i.e. to maximise the value of *dispatched load* based on *dispatch bids* less the combined cost of *dispatched generation* based on *generation dispatch offers*, *dispatched network services* based on *network dispatch offers*, and *dispatched market ancillary services* based on *market ancillary service offers* subject to:

(1) dispatch offers, dispatch bids and market ancillary service offers; ... “

The value of *dispatched load* equals (dispatched load x dispatch bid band price, as referred to regional reference node), summed for all scheduled loads.

In accordance with the objective of maximising the value of spot market trading, the energy and FCAS bands of scheduled loads and scheduled generating units are jointly scheduled to determine the least cost/greatest value way of satisfying both the energy demand and FCAS requirements for all regions.

Note that the scheduled amounts of energy and FCAS are jointly limited to the FCAS offer trapezium constraints as defined in the relevant FCAS offer for that dispatch or trading interval.

The total FCAS enabled from a scheduled load is limited to the FCAS Maximum Availability in its FCAS offer.

Energy dispatch plus FCAS enabled from a scheduled load must be less than the FCAS Enablement Maximum in its FCAS offer.

Energy dispatch less FCAS enabled from a scheduled load must be greater than the FCAS Enablement Minimum in its FCAS offer.

Normally-on versus Normally-off status

A scheduled load is registered as either normally-on or normally-off. The classification by AEMO of whether a scheduled load is either normally-on or normally-off is based on whether the metered consumption of that load has been included as a component of the metered demand calculation for the associated region. If the metered consumption of the load has been included (as that load is typically consuming power), then this load is defined to be normally-on - otherwise it is normally-off.

The NEMDE Solver algorithm schedules generation and load to meet the forecast non-dispatchable demand in each region. The Pre-dispatch process uses the normal operating

status information for loads in the adjustment of the Pre-dispatch demand forecast to determine non-dispatchable demand. As it is assumed that the Pre-dispatch demand forecasts provided by AEMO are based upon historical records which include the metered demand of normally-on scheduled loads, then for each trading interval the Pre-dispatch process must firstly subtract the total bid availability of all normally-on scheduled loads in the region from the Pre-dispatch demand forecast for that region. This adjustment assumes that the bid availability of a normally-on scheduled load closely reflects the metered demand of that load.

Apart from this adjustment, neither the On-line Dispatch, 5MPD nor Pre-dispatch processes pre-suppose any normal operating state for a scheduled load, and the calculation of consumption targets are based solely upon the bid prices submitted in the participant's dispatch bid. All loads then receive a dispatch target indicating their scheduled consumption of electricity. The bid structure for normally-on and normally-off scheduled loads has the same interpretation in both cases.

Energy Ramp Rates

Energy Ramp Up and Ramp Down Rates are converted by the NEMDE dispatch algorithm into respective upper and lower constraints on the electricity consumption that can be scheduled on a scheduled load by the end of the dispatch or trading interval.

The upper bound is the initial consumption at the start of a dispatch or trading interval *plus* the maximum amount by which that initial consumption can increase over the interval, as indicated by the Ramp Up Rate multiplied by the number of minutes in the interval.

The lower bound is the initial consumption at the start of a dispatch or trading interval *less* the maximum amount by which that initial consumption can decrease over the interval, as indicated by the Ramp Down Rate multiplied by the number of minutes in the interval.

Energy Band Price Tie-breaking

If two scheduled loads in the same region have the same referred band price and these two bands are marginally dispatched, then the price tie-breaking model calculates the sharing of load between the two bands. This is done by applying to each band the calculated ratio of the scheduled load band MW to the total MW available from both the price-tied bands.

It should be noted that there are limitations to this procedure. The bands must be in the same region and they must both belong to scheduled generating units or both belong to scheduled loads. Furthermore, there are no tie-breaking rules applied to price-tied FCAS offers.

Fast Start Commitment & Dispatch (On-line Dispatch only)

The Fast Start commitment, decommitment and inflexibility profile constraints are only applied in On-line Dispatch. A fast start scheduled load is committed (that is, commences to follow its bid FSIP) on the first occasion that a non-zero energy consumption target is calculated by the first-pass fast start commitment calculation of the On-line dispatch process.

The scheduled load then:

1. Prepares to be loaded over the bid T1 Mode time (during which time the consumption targets are zero MW),
2. Ramps up its consumption to a bid minimum loading level over the bid T2 Mode time, at the rate calculated as (bid minimum loading level / T2 time),
3. Is constrained to consume at or above its bid minimum loading level over bid T3 Mode time,
4. Is constrained to consume at or above a calculated minimum loading level which reduces from the bid minimum loading level down to zero MW over bid T4 Mode time.

On completion of T4 Mode time the Fast Start scheduled load is decommitted on the first occasion that a zero energy consumption target is calculated by the On-line Dispatch process, and is then prepared to be re-committed in subsequent On-line Dispatch runs.

Note that a Fast Start scheduled load cannot set market energy price while operating in inflexible loading Modes 0 (off-line), 1 or 2. Also note that a Fast Start scheduled load is subject to any overriding energy ramp rates while operating in Modes 3 or 4. Scheduled loads (both normally-on and normally-off) are treated in same way as scheduled generating units under this model.

Also note that the Fast start design only provides for a minimum consumption time (T3 time), not a maximum consumption time nor a maximum or minimum off-time (all of which must be handled by the market participant through re-bidding).

The Fast Start dispatch process is designed to automatically send a unit commitment instruction to the owner of a Fast Start unit to advise that it is now economically viable for that scheduled load to commence upon a participant-specified pattern of electricity consumption (its fast start inflexibility profile) given the current market price and level of demand. Note however that the registered normal operating status of a scheduled load is not used in the Fast Start dispatch decision process, and both the normally-on and normally-off types of scheduled loads can participate equally in the Fast Start commitment decision and dispatch process.

Clearly if a market participant bids a scheduled load so that the resulting dispatch exhibits a scheduled consumption pattern similar to that of a normally-on load (that is, bids with at least one band price always greater than market price) then the current Fast Start model is not likely to ever be activated for that type of load.

Daily Energy Constraint (Pre-dispatch only)

Daily Energy Constraints are used only in Pre-dispatch to limit the total amount of energy consumption that can be scheduled on an energy-constrained scheduled load from the start of the trading day onwards.

Market Pricing

As the price bands of scheduled loads can be marginally or partially dispatched by the NEMDE Solver algorithm, bands so dispatched are able to set the market price (either energy or any FCAS) for a dispatch or trading interval.

Reporting

Energy Dispatch Target (Total Cleared)

Scheduled load energy targets scheduled by the on-line Dispatch process represent the amount of electricity consumption (in MW) that is required for a normally-on or normally-off scheduled load for the specified dispatch interval. These targets are confidentially reported to the relevant market participant in electronically transmitted text files updated after every Dispatch run.

Scheduled energy consumption profiles that are determined in 5MPD and Pre-dispatch are indicative forecasts only.

Note that the NEMDE Solver algorithm employs linear programming techniques to solve. Therefore the reported dispatch targets for both scheduled generating units and scheduled loads are of a continuous nature rather than being quantised or integer values.

This means that for a scheduled load that naturally exhibits a quantised loading response to dispatch instructions (such as a pump) it becomes more important to construct bids so that the Dispatch process is unlikely to schedule partial loading within any bands of that unit. This can be achieved, for example, through pricing bands sufficiently away from the likely market clearing price.

FCAS Enabling Targets

Scheduled load FCAS Raise enabling targets scheduled by the on-line Dispatch process represent the amount of electricity consumption (in MW) on a normally-on or normally-off scheduled load that is required to be armed (enabled) and ready to automatically shed in the event of a defined power system frequency fall for the specified dispatch interval.

These targets are again confidentially reported to the relevant market participant in electronically transmitted text files updated after every Dispatch run.

Scheduled FCAS enabling targets that are determined in 5MPD and Pre-dispatch are again indicative forecasts only.

TABLE 1 : REFERENCES TO DISPATCHABLE LOADS IN SPD FORMULATION

SECTION OR EQN	TOPIC	DESCRIPTION
2.5	Quotes	Quote, or Trade Type <i>tt</i> , is either <i>LDOF</i> (for a dispatchable load energy bid) or one of the FCAS market offer types, and are made by energy customers.
2.7	Security Measures	Dispatchable loads are used in generic constraints.
3.1	Objective Function	<p>There are Ramp Rate & Trader Bid constraint violation penalties defined for dispatchable loads.</p> <p>The objective function of the NEMDE bid/offer clearing model is described as follows:</p> $(3.1) \quad \begin{aligned} & \text{Min} \sum_{(du,tt,t,ns) \in TBK} TBMW(du,tt,t,ns) * TBP(du,tt,t,ns) \\ & \quad + MNSPObjective \\ & \quad + ViolationPenalizingTerms \end{aligned}$ <p>where <i>TBMW(du,tt,t,ns)</i>: Band MW of band <i>ns</i> of quote type <i>tt</i> from dispatchable load <i>du</i> at time <i>t</i>. By convention, Band MW is negative for demand bids (for dispatchable loads) and positive for all the other quotes;</p>
4.5	Pre-dispatch Demand calculation	The regional demand forecast of a region is adjusted by subtracting the total availability bid in for all normally-on dispatchable loads in the region.

SECTION OR EQN	TOPIC	DESCRIPTION
		<p>$DB_{t,i}^{est}$: Estimation of demand that will be dispatched by NEMDE for interval t. Is equal to the sum of the capacity of normally on dispatchable loads.</p>
4.5.2	Total Load dispatched	<p>$DB_{t,i}$:</p> <p>is the total MW dispatched for consumption by dispatchable loads du in region i at time t, expressed as:</p> $DB_{t,i} = \sum_{(du) \in UL_i} DULD(du,t)$ <p>where $DULD(du,t) \geq 0$:</p>
4.5.3	Load Dispatch Target =Sum(Energy Bands)	<p>Total energy dispatched MW over all bands ns of a dispatchable load du at time t.</p> $DULD(du,t) = \sum_{(du,tt,ns) \in LDOF} TBMW(du,tt,t,ns) + DeficitOfferMW(du,t)$ <p>$DeficitOfferMW(du,t) > 0$: Deficit MW demand offer for dispatchable load du at time t</p>
4.6.3	Generic Constraint market node net flow	<p>Generic constraints are modeled as linear functions of total regional generation MW, interconnector MW flows, and Net MW or FCAS at a connection point cp for a trade type tt. Net MW at a connection point equals dispatchable generating unit $DUGEN$ output target minus dispatchable load $DULD$ consumption target:</p>

SECTION OR EQN	TOPIC	DESCRIPTION
		$NETMW(cp,tt) = DUGEN(cp,tt) - DULD(cp,tt)$
4.7	Generic Constraint Dynamic RHS Terms	Dispatchable load initial consumption can be used as a generic constraint dynamic RHS 'T' (Trader) term
4.8.1	Intervention Initial Conditions	For the first run of an Intervention Pricing period, dispatchable load initial consumption is used as the initial condition; in subsequent Intervention Pricing runs the previous dispatchable load consumption target is used.
4.9	Trader Energy Capacity constraint	The amount of dispatchable load scheduled, $DULD(du,t)$, is constrained by its capacity as follows: $DULD(du,t) - DeficitTraderEnergyCapacity(du,t) \leq DULD^{max}(du,t)$ where; $DULD^{max}(du,t)$: maximum capacity (bid availability) for dispatchable load du at time t .
5	FCAS – General	Dispatchable loads are eligible to be enabled for FCAS Raise or Lower services, subject to their availability to do so.
5.6	Joint Energy/FCAS Upper Capacity constraints	Dispatchable load are jointly limited in providing energy consumption plus FCAS Lower5Min plus FCAS LowerRegulation, below the maximum of their offered FCAS Lower5Min or FCAS LowerRegulation Enablement Maximums.

SECTION OR EQN	TOPIC	DESCRIPTION
		$ \begin{aligned} & DULD(du,t) \\ & + L5UpperCoef(du,t) \cdot L5MW \overline{du,t} \\ & + L5REUpperCoef(du,t) \cdot L5REMW \overline{du,t} \\ & - L5JointUpperDeficit(du,t) \\ & \leq \text{Max}(L5EnablementMax \overline{du,t}, L5REENablementMax \overline{du,t}) \end{aligned} $
5.7	Joint Energy/FCAS Lower Capacity constraints	<p>Dispatchable loads are jointly limited in providing energy consumption less FCAS Raise5Min less FCAS RaiseRegulation, above the minimum of their offered FCAS Raise5Min or FCAS RaiseRegulation Enablement Minimums.</p> $ \begin{aligned} & DULD(du,t) \\ & - R5LowerCoef(du,t) \cdot R5MW \overline{du,t} \\ & - R5RELowerCoef(du,t) \cdot R5REMW \overline{du,t} \\ & + R5JointLowerSurplus(du,t) \\ & \geq \text{Min}(R5EnablementMin \overline{du,t}, R5REENablementMin \overline{du,t}) \end{aligned} $
5.8	Joint Energy/Reg FCAS Lower Ramping constraints	<p>In Dispatch, Dispatchable loads are jointly limited in providing energy consumption plus FCAS LowerRegulation below their SCADA ramp up rate x 5.</p> $ \begin{aligned} & DULD(du,t) + L5REMW \overline{du,t} - L5REJointRampDeficit(du,t) \\ & \leq \text{PreviousMW} \overline{du,t} + SCADARampUpRate_{du} \times \text{TimePeriodConstant} \end{aligned} $
5.9	Joint Energy/Reg FCAS Raise Ramping	<p>In Dispatch, Dispatchable loads are jointly limited in providing energy consumption less FCAS RaiseRegulation above their SCADA ramp down rate x 5.</p>

SECTION OR EQN	TOPIC	DESCRIPTION
	constraints	$DULD(du,t) - R5REMW_{du,t} + R5REJoint RampSurplus(du,t) \geq PreviousMW_{du,t} - SCADARampDnRate_{du} \times TimePeriodConstant$
8.4	Energy Ramp Up Rate	<p>Ramp Up Rate constraints apply for dispatchable load du at time t.</p> $DULD(du,t) - DULD(du,t_0) - DeficitRampRate(du,t) \leq UpRR(du,t) * DispPeriod$
8.5	Energy Ramp Down Rate	<p>Ramp Down Rate constraints apply for dispatchable load du at time t.</p> $DULD(du,t_0) - DULD(du,t) - SurplusRampRate(du,t) \leq DwnRR(du,t) * DispPeriod$
8	Energy Ramp Rates ignored	<p>If the total MW value of its bid/offer bands is zero, ramp-rate constraints for the unit will be ignored. If the unit is a fast start unit and it is targeted to be in mode 0, 1 or 2 its ramp rate constraints are also ignored, as inflexibility profiles have to be observed.</p>
9	On-line dispatch Fast Start Inflexibility Model	<p>The description of the fast-start inflexibility model applies to both dispatchable generating units and dispatchable loads.</p>
9.2	On-line dispatch Fast Start Mode 1	<p>During Mode 1 the dispatchable load du will be synchronising over bid T1 time & therefore its energy target = zero MW:</p>

SECTION OR EQN	TOPIC	DESCRIPTION
		$DULD(du,t) - ProfileDeficitMW(du,t) \leq 0.000001$
9.3	On-line dispatch Fast Start Mode 2	<p>During Mode 2 the dispatchable load du will be ramping to minimum load over bid T2 time & therefore its energy target =</p> $DULD(du,t) + ProfileSurplusMW(du,t) - ProfileDeficitMW(du,t)$ $= T(du) \cdot MinLoading(du) / T_2(du)$
9.4	On-line dispatch Fast Start Mode 3	<p>During Mode 3 the dispatchable load du will be constrained above its bid minimum loading level for bid T3 time:</p> $DULD(du,t) + ProfileSurplusMW(du,t) \geq MinLoading(du)$
9.5	On-line dispatch Fast Start Mode 4	<p>During Mode 4 the dispatchable load du will be constrained above its bid minimum loading level as ramped down to zero MW over bid T4 time:</p> $DULD(du,t) + ProfileSurplusMW(du,t) \geq \left(\frac{T_4(du) - T(du)}{T_4(du)} \right) \cdot MinLoading(du)$
11.3	Pre-dispatch Daily Energy Constraint Model	Under the Pre-dispatch energy-constrained model the energy target for dispatchable load du at time t is limited to the bid daily $EnergyAvailable^{max}$.

SECTION OR EQN	TOPIC	DESCRIPTION
		$DULD(du,t) * DispPeriod - DeficitEnergy(du,t) \leq EnergyAvailable^{max}(du,t)$
13.1	On-line dispatch Demand calculation	<p>The sum of metered regional initial MW generation values minus the sum of regional metered dispatchable load initial MW consumption values is used as the regional demand forecast against which NEMDE Dispatch schedules:</p> $PD_a = \max \left(\begin{aligned} & \sum_{(du) \in U_a} PG_{du}^{metered} - \sum_{(du) \in U_a} DP_{du}^{metered} \\ & - InitialNetInterchange_{a,t} \\ & - RegionalLossEst_{a,t} \\ & - \sum_{mnspl} MNSPLossEst_{mnspl,a,t} \\ & + AggregateDispatchError_{a,t} \\ & + DeltaForecast_{a,t} \end{aligned} \right), 0$ <p>where: $DP_{du}^{metered}$ = actual metered initial MW consumption for dispatchable load du</p>